


PLAN

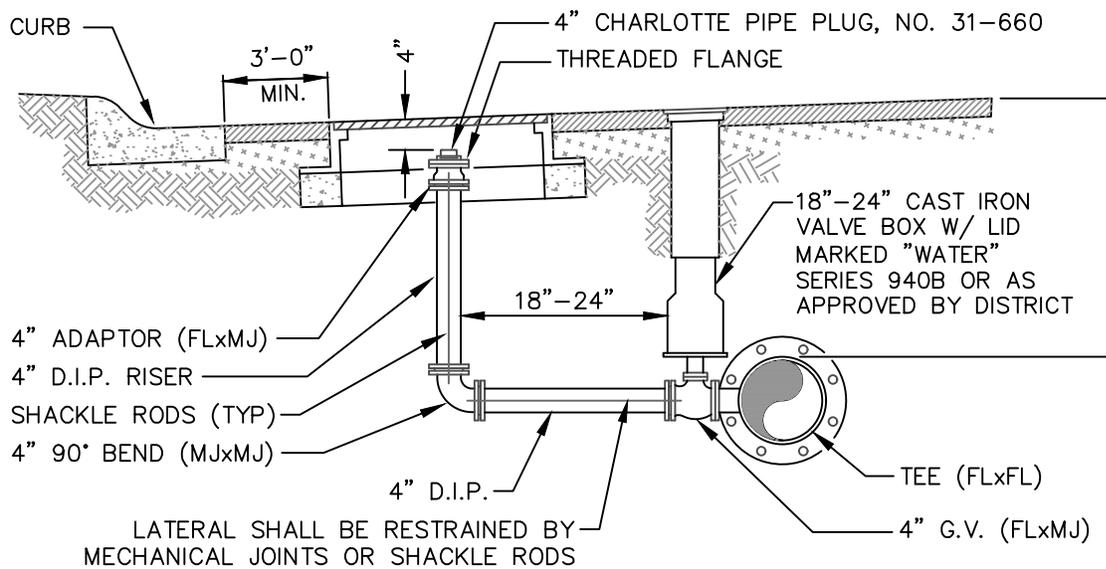

ELEVATION

NOTES:

1. LOCATE BLOW-OFF AS CLOSE AS POSSIBLE TO MAIN, OR AS DIRECTED BY DISTRICT.
2. THE GROUND WITHIN 3' RADIUS OF BLOWOFF SHALL BE GRADED UNIFORMLY.
3. ALL MECHANICAL JOINTS SHALL BE RESTRAINED WITH MEGALUG OR APPROVED EQUAL.
4. IF SHACKLE RODS ARE USED, THEY SHALL BE TWO EA., 3/4" GALV. STEEL TIE RODS WITH ONE HEAVY COAT OF COAL TAR PRESERVATIVE ON TIE RODS, NUTS AND BOLTS AFTER INSTALLATION.



**IN PAVING 4" BLOWOFF ASSY.
FOR 8" AND LARGER MAINS**

REVISION DATE NOVEMBER 1, 2022	SCALE NTS	DISTRICT APPROVAL <i>Gregory G. Hill, P.E.</i>	DATE APPROVED APRIL 27, 2023
FILE NAME W-10.DWG		DWG. NO.	W-10