


PLAN

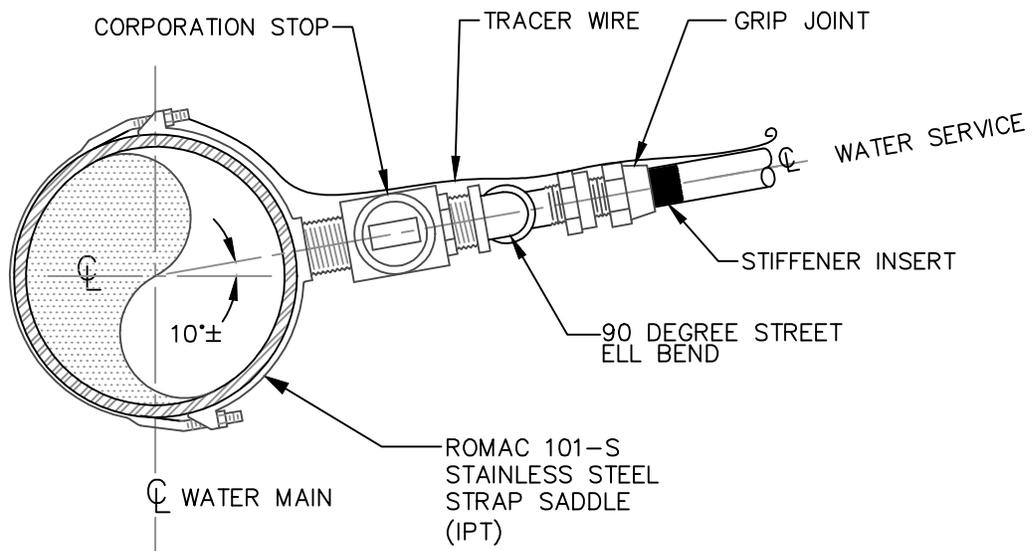

ELEVATION

NOTES:

1. SERVICE LINE FITTINGS: ALL FITTINGS SHALL BE CAST FROM WATER WORKS BRASS CONFORMING TO C800. DO NOT BACKFILL UNTIL ALL FITTINGS HAVE BEEN INSPECTED BY THE DISTRICT.
2. MUNICIPAL SERVICE PIPE: IRON PIPE SIZE ID, ASTM D-2239, SIDR 7, PE 4710 (POLY PIPE) WITH 14 GAUGE SOLID CORE COATED TRACER WIRE. STRIP END AND CLAMP TO SADDLE.
3. SHALL BE USED ONLY FOR SINGLE SERVICES.



**WATER SERVICE CONNECTION
ONE INCH**

REVISION DATE APRIL 11, 2023	SCALE NTS	DISTRICT APPROVAL <i>Gregory G. Hill, P.E.</i>	DATE APPROVED APRIL 27, 2023
FILE NAME W-15.DWG	DWG. NO.		W-15